


# Modern Grape Ape Badder

<b>Sample ID:</b> 2509AFL1609.6392	<b>Internal Lab ID:</b> ATL-32037	<b>Client</b>
Strain: MODERNGABAD-091025.1		<b>Modern Distribution</b>
Matrix: Concentrates & Extracts	Received: 09/11/2025	Lic. #
Type: Batter/Badder	Completed: 10/07/2025	1579 Prospect st
Unit Weight: 1 g	Batch#: MODERNGABAD-091025.1	High Point, NC 27260.

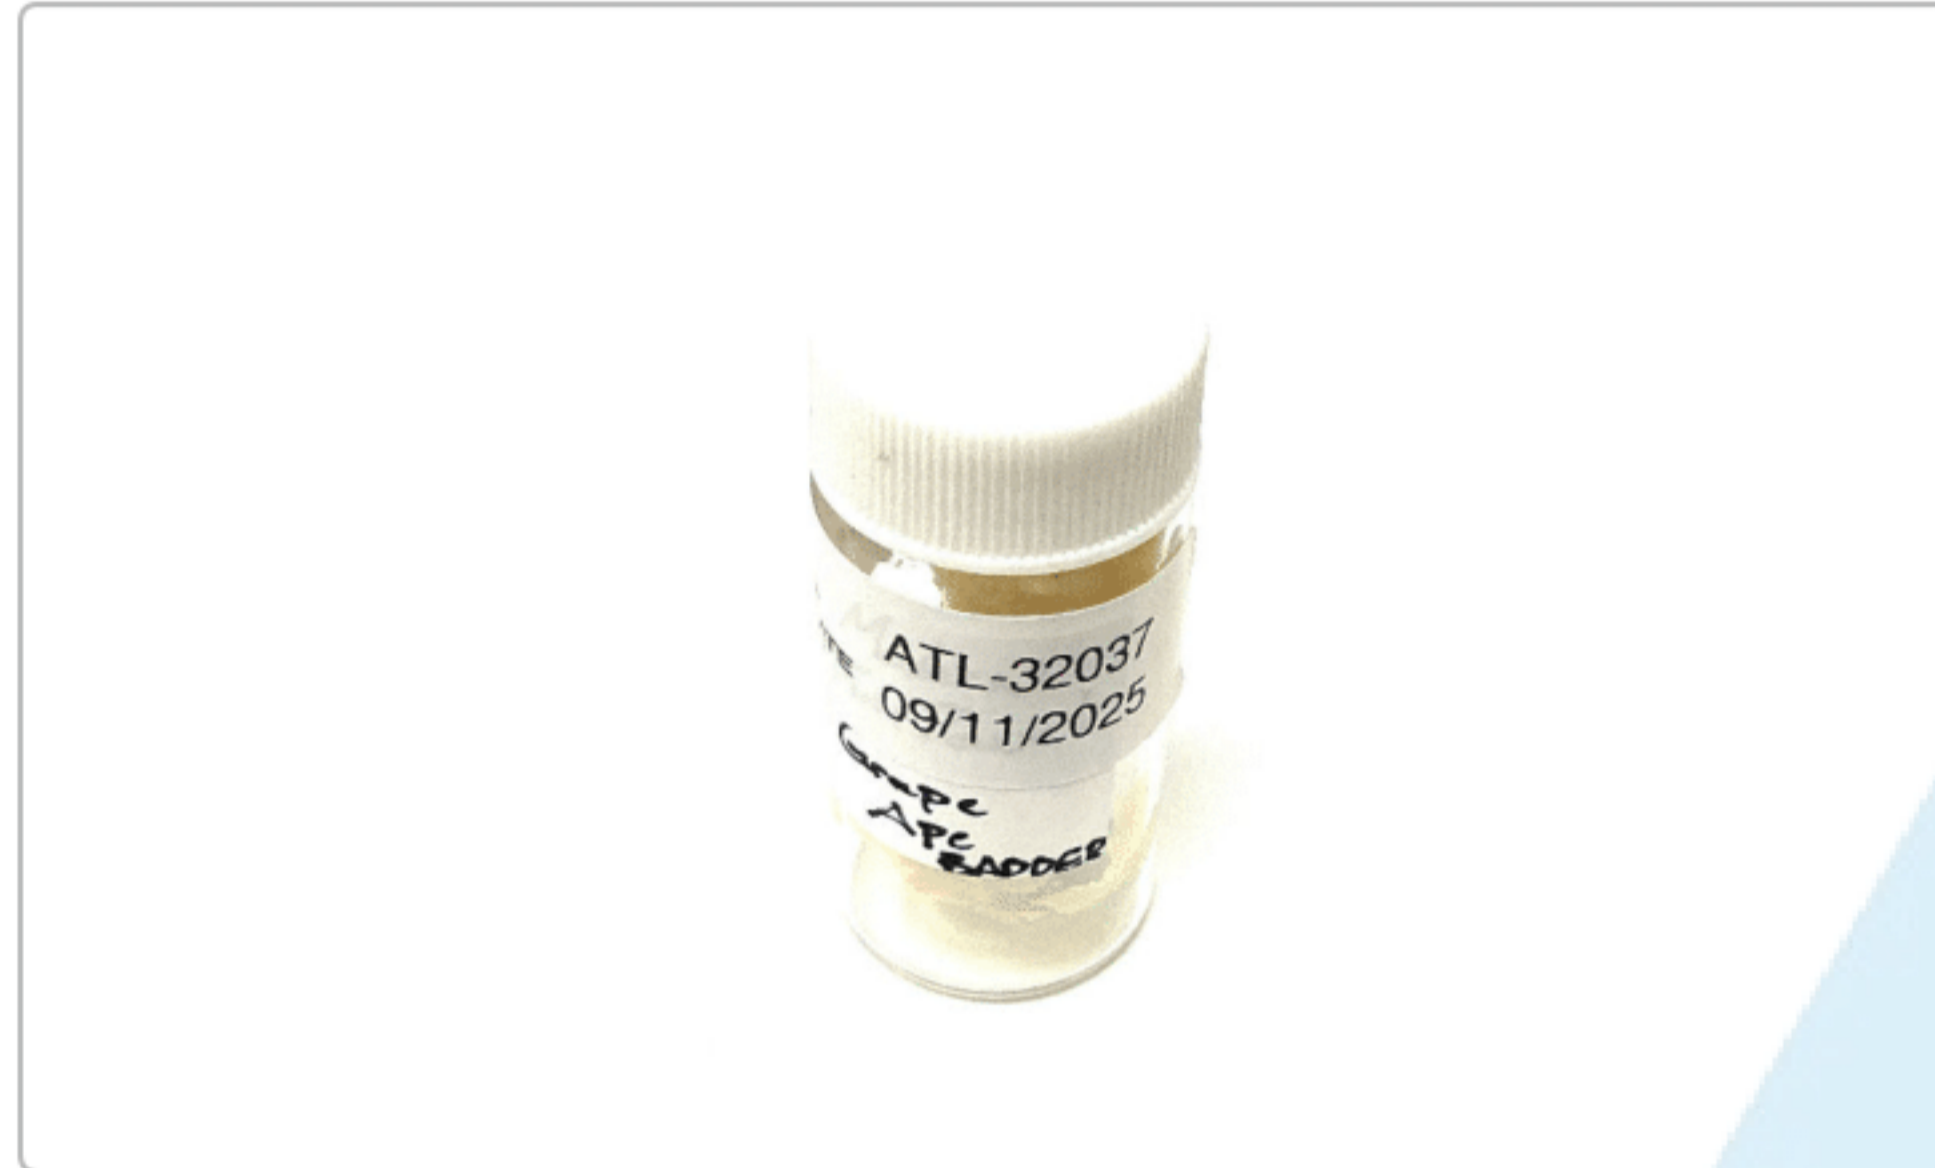

## Summary

Test	Date Tested	Result
Batch		Pass
Cannabinoids	09/11/2025	Complete
Residual Solvents	10/03/2025	Pass
Microbials	10/03/2025	Pass
Mycotoxins	10/01/2025	Pass
Pesticides	10/01/2025	Pass
Heavy Metals	10/03/2025	Pass
Foreign Matter	10/03/2025	Pass

## Basic Potency

Complete

<b>49.76%</b> Total THC	<b>6.76%</b> Total CBD	<b>88.45%</b> Total Cannabinoids
----------------------------	---------------------------	-------------------------------------

Analyte	LOD %	LOQ %	Result %	Result mg/unit	Analyte	LOD %	LOQ %	Result %	Result mg/unit
CBDVa		0.02	ND	ND	9S-HHC		0.03	ND	ND
CBDV		0.02	ND	ND	9R-HHC		0.03	ND	ND
CBDa		0.02	2.23	22.3	Δ9-THCH		0.02	ND	ND
CBGa		0.02	ND	ND	Δ8-THCH		0.02	ND	ND
CBG		0.02	1.02	10.2	Δ9-THCP		0.02	ND	ND
CBD		0.02	4.80	48.0	Δ8-THCP		0.02	ND	ND
THCV		0.02	ND	ND	Δ8-THCO		0.02	ND	ND
Δ8-THCV		0.02	ND	ND	Δ9-THCO		0.02	ND	ND
THCVa		0.02	ND	ND	9(S)-HHCP		0.02	ND	ND
CBN		0.02	23.66	236.6	9(R)-HHCP		0.02	ND	ND
Δ9-THC		0.02	ND	ND	11-Hydroxy-THC		0.02	ND	ND
Δ8-THC		0.02	ND	ND	1(S)-H4-CBD		0.02	ND	ND
(6aR,9S)-d10-THC		0.02	ND	ND	1(R)-H4-CBD		0.02	ND	ND
(6aR,9R)-d10-THC		0.02	ND	ND	Δ9-THCB		0.02	ND	ND
CBC		0.02	ND	ND	Δ8-THCB		0.02	ND	ND
CBCa		0.02	ND	ND	CBDp		0.02	ND	ND
THCa		0.02	56.74	567.4	<b>Total</b>			<b>88.45</b>	<b>884.5</b>

Document ID: CoA-1 Potency Rev. 6, Test Method: TM-2  
Date Tested: 09/11/2025  
Equations: Total Active THC = 9THC + (0.877 \* THCA), Total Active CBD = CBD + (0.877 \* CBDA)  
ISO/IEC 17025:2017 Accreditation No. 118038

<b>NT</b> Not Tested Document ID: <b>Moisture Content</b>	<b>NT</b> Not Tested Document ID: <b>Water Activity</b>	<b>Pass</b> Document ID: CoA-4 Foreign Matter Rev. 2, Test Method: TM-4.3 <b>Foreign Matter</b>
--	--	---



Paulo Gonzalez  
Laboratory Director  
10/07/2025

Confident LIMS  
All Rights Reserved  
coa.support@confidentlms.com  
(866) 506-5866  
www.confidentlms.com



Abbreviations: LOQ = Limit of Quantification, LOD = Limit of Detection, ND = Not Detected, NT = Not Tested, ppm = Parts per Million, ppb = Parts per Billion, CFU/g = Colony Forming Units per Gram.

This report shall not be reproduced without written approval of Accurate Test Labs and results are confidential unless disclosure is explicitly authorized. Results relate only to the samples and batches tested. Test results are for informational purposes only and Accurate Test Labs makes no claims as to the safety or risks associated with this product. Pass/Fail results reflect compliance with applicable federal, state, tribal and local regulations unless otherwise specified. The measurement of uncertainty is not included unless explicitly required by law and is available upon request. Testing was performed using validated methodologies and is accredited pursuant to ISO/IEC 17025:2017.

# Modern Grape Ape Badder

<b>Sample ID:</b> 2509AFL1609.6392	<b>Internal Lab ID:</b> ATL-32037	<b>Client</b>
Strain: MODERNGABAD-091025.1		<b>Modern Distribution</b>
Matrix: Concentrates & Extracts	Received: 09/11/2025	Lic. #
Type: Batter/Badder	Completed: 10/07/2025	1579 Prospect st
Unit Weight: 1 g	Batch#: MODERNGABAD-091025.1	High Point, NC 27260.


## Pesticides

Pass

Analyte	LOD PPB	LOQ PPB	Limit PPB	Result PPB	Status	Analyte	LOD PPB	LOQ PPB	Limit PPB	Result PPB	Status
Abamectin			100	ND	Pass	Fludioxonil			100	ND	Pass
Acephate			100	ND	Pass	Hexythiazox			100	ND	Pass
Acequinocyl			100	ND	Pass	Imazalil			100	ND	Pass
Acetamiprid			100	ND	Pass	Imidacloprid			400	ND	Pass
Aldicarb			100	ND	Pass	Kresoxim Methyl			100	ND	Pass
Azoxystrobin			100	ND	Pass	Malathion			200	ND	Pass
Bifenazate			100	ND	Pass	Metalaxyl			100	ND	Pass
Bifenthrin			100	15.402	Pass	Methiocarb			100	ND	Pass
Boscalid			100	ND	Pass	Methomyl			100	ND	Pass
Captan			700	ND	Pass	Mevinphos			100	ND	Pass
Carbaryl			500	ND	Pass	Myclobutanil			0	ND	Pass
Carbofuran			100	ND	Pass	Naled			250	ND	Pass
Chlorantraniliprole			1000	ND	Pass	Oxamyl			500	ND	Pass
Chlordane			100	ND	Pass	Paclobutrazol			100	ND	Pass
Chlorfenapyr			100	ND	Pass	Parathion Methyl			100	ND	Pass
Chloromequat chloride			1000	ND	Pass	Pentachloronitrobenzene			150	ND	Pass
Chlorpyrifos			100	ND	Pass	Permethrin			100	ND	Pass
Clofentezine			200	ND	Pass	Phosmet			100	ND	Pass
Coumaphos			100	ND	Pass	Piperonyl Butoxide			3000	ND	Pass
Cyfluthrin			500	ND	Pass	Prallethrin			100	ND	Pass
Cypermethrin			500	ND	Pass	Propiconazole			100	ND	Pass
Daminozide			100	ND	Pass	Propoxur			100	ND	Pass
Diazinon			100	ND	Pass	Pyrethrins			500	ND	Pass
Dichlorvos			100	ND	Pass	Pyridaben			200	ND	Pass
Dimethoate			100	ND	Pass	Spinetoram			200	ND	Pass
Dimethomorph			200	ND	Pass	Spinosad			100	ND	Pass
Ethoprophos			100	ND	Pass	Spiromesifen			100	ND	Pass
Etofenprox			100	ND	Pass	Spirotetramat			100	ND	Pass
Etoazole			100	ND	Pass	Spiroxamine			100	ND	Pass
Fenhexamid			100	ND	Pass	Tebuconazole			100	ND	Pass
Fenoxycarb			100	ND	Pass	Thiacloprid			100	ND	Pass
Fenpyroximate			100	ND	Pass	Thiamethoxam			500	ND	Pass
Fipronil			100	ND	Pass	Trifloxystrobin			100	ND	Pass
Fonicamid			100	ND	Pass						

Document ID: CoA-2 Pesticides Rev. 1, Test Method: TM-1  
Date Tested: 10/01/2025  
Action limits based on Florida Department of Agriculture and Consumer Services, Rule 5K-4.034 § 5(b)



  
Paulo Gonzalez  
Laboratory Director  
10/07/2025

Confident LIMS  
All Rights Reserved  
coa.support@confidentlms.com  
(866) 506-5866  
www.confidentlms.com



Abbreviations: LOQ = Limit of Quantification, LOD = Limit of Detection, ND = Not Detected, NT = Not Tested, ppm = Parts per Million, ppb = Parts per Billion, CFU/g = Colony Forming Units per Gram.

This report shall not be reproduced without written approval of Accurate Test Labs and results are confidential unless disclosure is explicitly authorized. Results relate only to the samples and batches tested. Test results are for informational purposes only and Accurate Test Labs makes no claims as to the safety or risks associated with this product. Pass/Fail results reflect compliance with applicable federal, state, tribal and local regulations unless otherwise specified. The measurement of uncertainty is not included unless explicitly required by law and is available upon request. Testing was performed using validated methodologies and is accredited pursuant to ISO/IEC 17025:2017.